


# CATHODIC PROTECTION SYSTEM ASSESSMENT



# PROJECT LOCATION

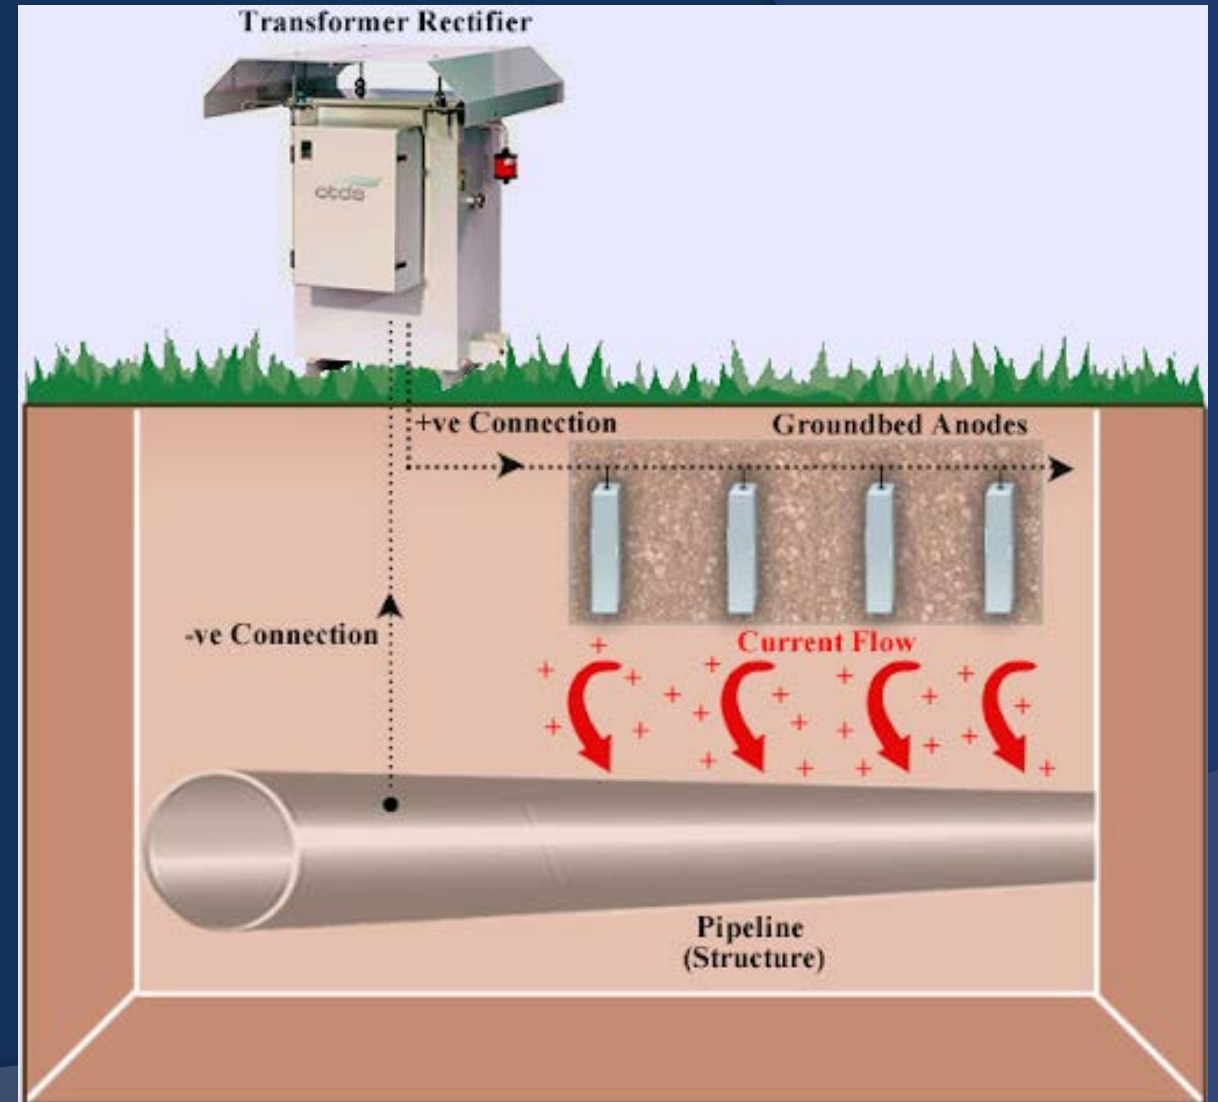

**CATHODIC PROTECTION  
TEST STATION**

**Stillwater WTP**



**Kaw Pump  
Station**

KAW LAKE



**DISTRIBUTION SYSTEM**

# KAW PUMP STATION



# CENTRAL TOWER



# STRATEGIC PLAN ALIGNMENT

- ◎ Priority #4 Connected Spaces – Objective 4.2 – Continue practices that provide well-planned and highly reliable public utility and infrastructure systems that serve the needs of the public.

## BUDGET/FUNDING

- ◎ \$175,700/Water Fund

# RECOMMENDATION

Staff recommends a motion to:

- ◎ Authorize the General Manager to execute the professional services agreement with Freese and Nichols for assessment of the Cathodic Protection Systems;
- ◎ Authorize total expenditures not-to-exceed \$175,700 which includes a 10% contingency; and
- ◎ Approve the related budget amendment.